
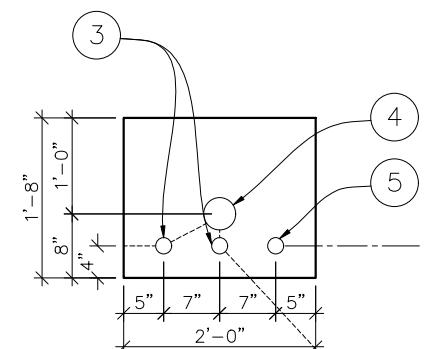


ALL PIPING INDICATED ON  
THIS SHEET IS NOT BY CXT


BELOW FLOOR PIPING - KEY NOTES

1. 4" CLEAN OUT TO GRADE.
2. 2" FLOOR DRAIN W/ FIELD INSTALLED TRAP SEAL (10" DIA BLOCKOUT)
3. 2" VENT PIPES EXTENDED 12" ABOVE FINISHED FLOOR LEVEL, PROVIDE TEST PLUG. (24"x20" BLOCKOUT)
4. 4" WASTE PIPE EXTENDED 12" ABOVE FINISHED FLOOR LEVEL, PROVIDE TEST PLUG. (24"x20" BLOCKOUT)
5. 2" TYPE K OR L ANNEALED "SOFT" COPPER WATER SERVICE EXTENDED 12" ABOVE FINISHED FLOOR LEVEL, PROVIDE CAP AT END. (24"x20" BLOCKOUT)
6. 30" MIN. BURY, PROVIDE TRACER TAPE.
7. MIN. BURY PER LOCAL REQUIREMENTS TO PROTECT AGAINST FREEZING AND DAMAGE.
8. ELECTRICAL STUB UP, (6" DIA BLOCKOUT)
9. 2" FLOOR DRAIN W/ FIELD INSTALLED TRAP SEAL (24" x 20" BLOCKOUT)

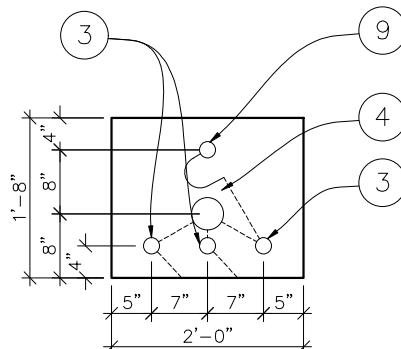

FLOOR DRAIN BLOCKOUTS & BELOW FLOOR PIPING

- CAST-IN DRAIN HOUSING (10" INSIDE DIM - PROVIDED BY CXT)
- FIELD INSTALLED GROUT, SLOPE TO DRAIN (CXT PROVIDED-INSTALLATION NOT BY CXT)
- 2" WASTE PIPE - STUB UP 12" ABOVE GRADE (NOT BY CXT)
- 2" TRAP SEAL PART# P26001 (CXT PROVIDED-INSTALLATION NOT BY CXT)
- P-TRAP ASSEMBLY (NOT BY CXT)
- 2" FLOOR DRAIN VENT RISER - STUB UP 12" ABOVE GRADE (NOT BY CXT)

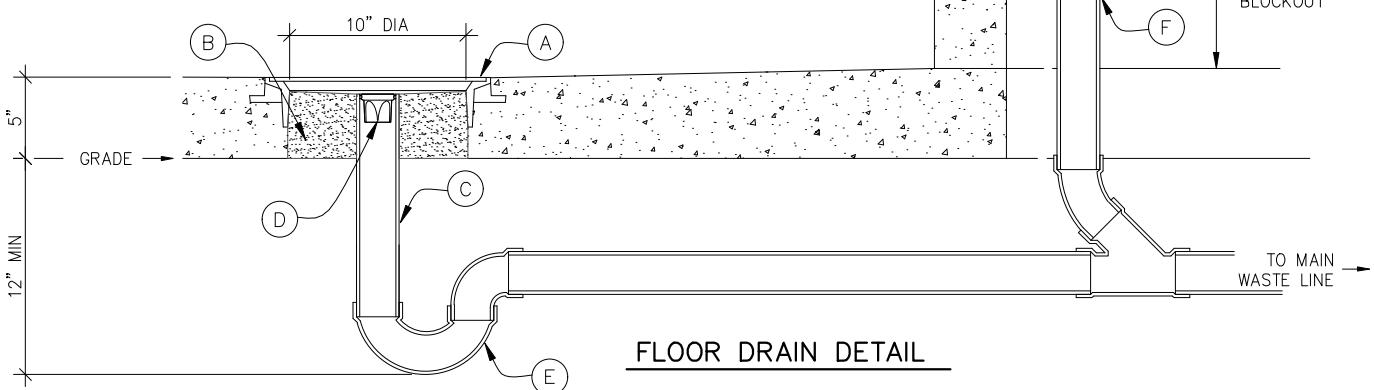

**PIPING LEGEND**

- BELOW FLOOR VENT PIPING SCH 40 PVC ASTM D2665 TYPE DWV
- BELOW FLOOR WASTE PIPING SCH 40 PVC ASTM D2665 TYPE DWV
- - - 2" TYPE "K OR L" ANNEALED "SOFT" COPPER WATER SERVICE ASTM B88

**LB Foster**  
CXT® Products

6707 E. Flamingo Ave. Bldg 300, Nampa, ID 83687  
901 N. Highway 77 Hillsboro, TX 76645  
362 Waverly Road Williamstown, WV 26187

PROJECT TITLE  
DK4  
BUILDING NUMBER DK4-015

NOTICE

The information contained herein is proprietary and the exclusive property of CXT Incorporated. The information may only be used by the original recipient for the purpose intended. Redistribution or distribution of this information is strictly prohibited without the prior written consent of CXT Incorporated. By allowing use of this information, CXT Incorporated grants no warranty, express or implied, including a warranty of merchantability or fitness for a particular purpose.

CXT Incorporated

REV.	DESCRIPTION	APPROVAL	DATE
1/4"=1'-0"			6-7-24
DRAWN	6.0GG	FILE NO.	DK4-015
CHECKED	N.PENNER	PLOT	48

FLOOR DRAIN LOCATIONS & BELOW FLOOR PIPING

DWG NO.	SHEET	REV.
DK4-19	19	0
	24	